


**DATE** November 11, 2024  
**REVISED** May 30, 2025  
**REFERENCE** Product Design Change  
**PRODUCT** Suction Accumulators

A design change has been implemented for Westermeyer Industries high pressure suction accumulator product line. New regulations for flammable A2L refrigerants require some applications to vent the fusible element outside. A 1/4" flare fusible union will be provided – rated to 430F. This requirement is to ensure any flammable refrigerant is removed from the occupied space.

This is a rolling change, so please verify stock before installing in a system that requires this specification. You may also reference UL 60335-2-40 to learn more about how this change may affect your system and component design.

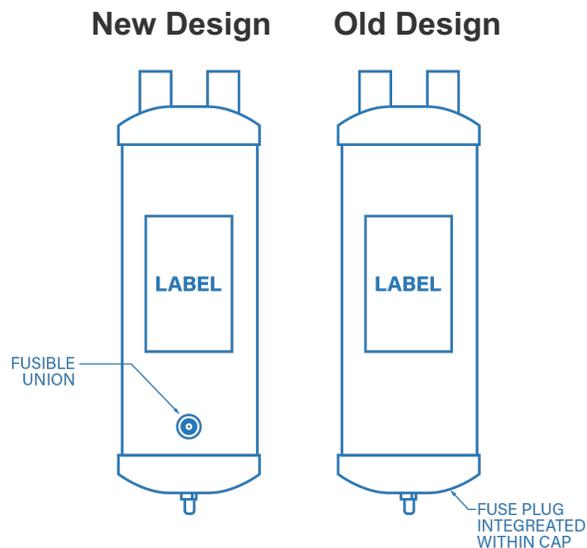

## Applicable Accumulators Models\*

Catalog Number	Accumulator Type	Max. Working Pressure
AH4-04	Standard	675 PSIG
AH4-05	Standard	675 PSIG
AH4-05A	Standard	675 PSIG
AH4-05B	Standard	675 PSIG
AH5-07	Standard	675 PSIG
AH5-07F	Standard	675 PSIG
AH6-11	Standard	675 PSIG
AH6-13	Standard	675 PSIG
AH6-15	Standard	675 PSIG
AH4-04-HP	Heat Pump	675 PSIG
AH4-05-HP	Heat Pump	675 PSIG
AH4-06-HP	Heat Pump	675 PSIG
AH5-07-HP	Heat Pump	675 PSIG
AH5-07F-HP	Heat Pump	675 PSIG
AH6-11-HP	Heat Pump	675 PSIG
AH6-11AE-HP	Heat Pump	675 PSIG
AH6-13-HP	Heat Pump	675 PSIG
AH6-13Z-HP	Heat Pump	675 PSIG
AH6-15-HP	Heat Pump	675 PSIG

\*Some custom and high-pressure models are also affected by this change. **Please contact your sales representative for more information.**